
Flucht- und Rettungsplan · Fire evacuation and safety plan

Corvane Biologics AG · Industriezone Rottenmatte, Visp · Building B, Level 2: aseptic filling

Notruf Emergency **118 · internal 2222**

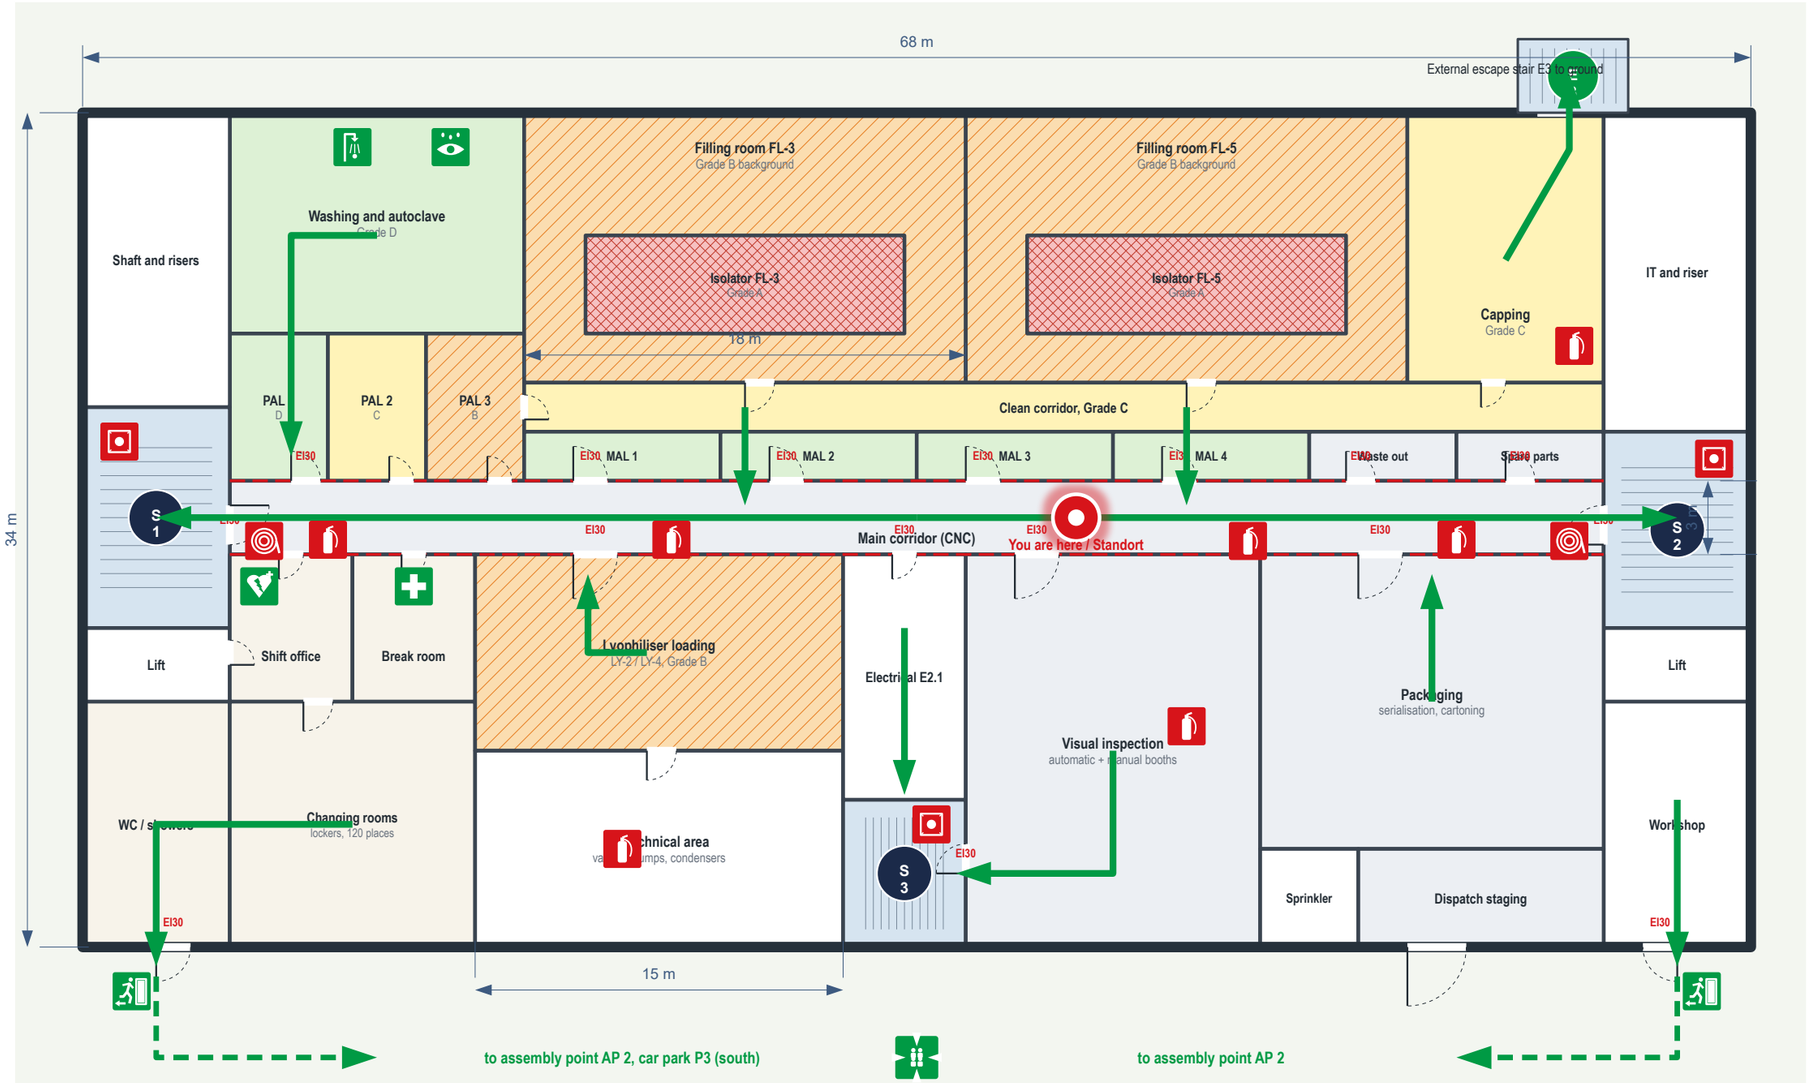


Legend

- Emergency exit / Notausgang
- Fire extinguisher / Feuerlöscher
- Fire hose reel / Wasserlöschposten
- Manual call point / Brandmelder
- First aid / Erste Hilfe
- Defibrillator (AED)
- Eye wash station / Augendusche
- Emergency shower / Notdusche
- Escape route / Fluchtweg
- Fire compartment boundary, doors EI30
- You are here / Standort

Clean-room grades (EU GMP Annex 1)

- Grade A, isolator
- Grade B
- Grade C
- Grade D
- Controlled, not classified
- Stair core

Building B, section: your level

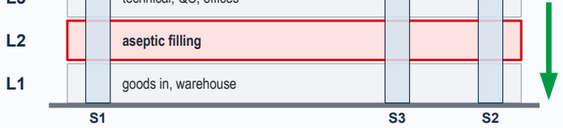

In case of fire / Im Brandfall

1 Raise the alarm: call point or 2222
2 Leave isolators safely: stop filling, close doors
3 Do not de-gown in Grade B: leave by the nearest exit
4 Do not use the lifts
5 Go to your assembly point and report to the warden

N

0 5 10 15 20 m (1:250)

Notes

Personnel in Grade A/B areas leave in gowns through the nearest marked exit; break-out panels in PAL 3 and the clean corridor.
Fire wardens Level 2: shift leader FL-3 (day), shift leader FL-5 (night). Evacuation drill: twice a year, last 12 May 2026.
Sprinkler valve station in room Sprinkler (Level 2, south). Fire brigade access via stair S2 and the east façade.

CORVANE BIOLOGICS

Health, Safety and Environment
Building B, Industriezone Rottenmatte


Building B, Level 2: aseptic filling

Drawing no. CB-B-FS-101	Revision C
Scale 1:250	Sheet 1 of 4
Approved R. Andenmatten, HSE manager	Date 09/30/2026

Flucht- und Rettungsplan · Fire evacuation and safety plan

Corvane Biologics AG · Industriezone Rottenmatte, Visp · Building B, Level 3: technical floor and QC

Notruf Emergency **118 · internal 2222**

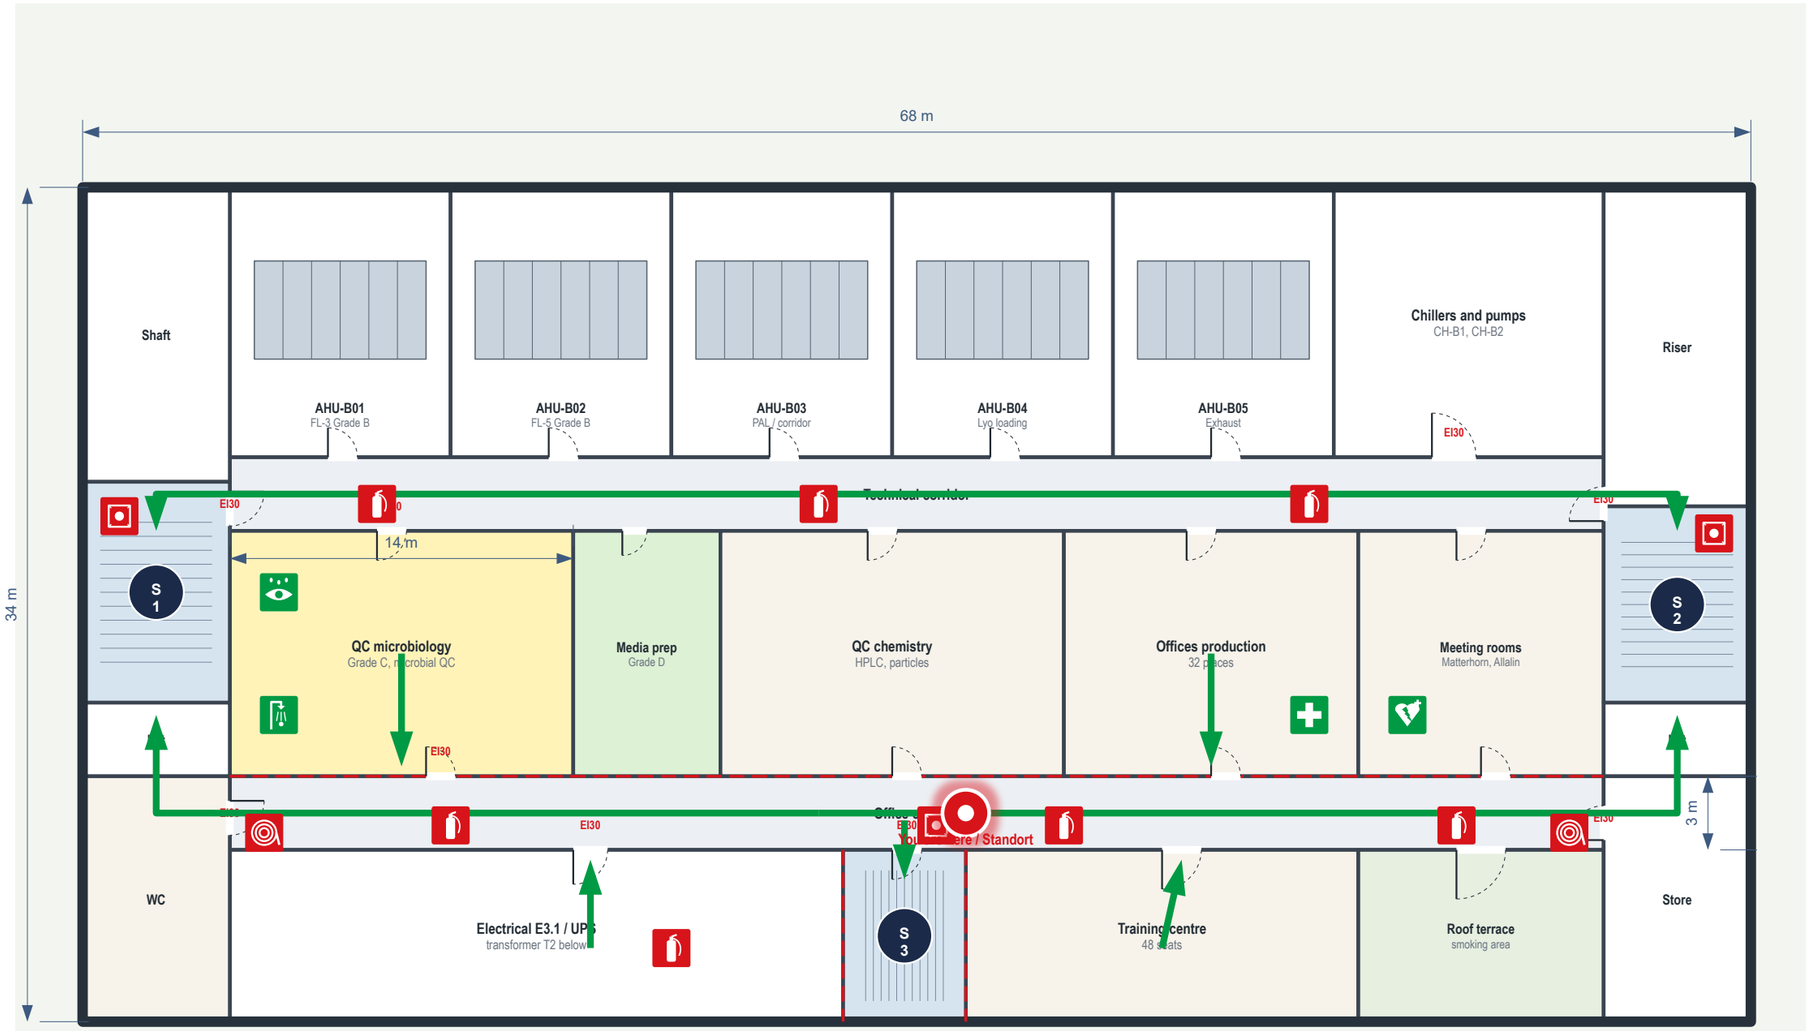


Legend

- Emergency exit / Notausgang
- Fire extinguisher / Feuerlöscher
- Fire hose reel / Wasserlöschposten
- Manual call point / Brandmelder
- First aid / Erste Hilfe
- Defibrillator (AED)
- Eye wash station / Augendusche
- Emergency shower / Notdusche
- Escape route / Fluchtweg
- Fire compartment boundary, doors EI30
- You are here / Standort

Clean-room grades (EU GMP Annex 1)

- Grade A, isolator
- Grade B
- Grade C
- Grade D
- Controlled, not classified
- Stair core

Building B, section: your level

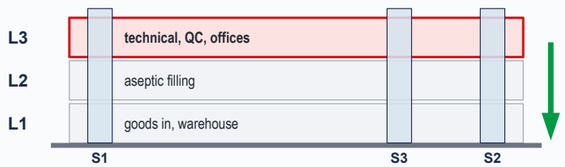

In case of fire / Im Brandfall

1 Raise the alarm: call point or 2222
2 Leave isolators safely: stop filling, close doors
3 Do not de-gown in Grade B: leave by the nearest exit
4 Do not use the lifts
5 Go to your assembly point and report to the warden

N

0 5 10 15 20 m (1:250)

Notes

Air handling units AHU-B01 to B05 shut down automatically on fire alarm; smoke dampers close in the technical corridor.
QC microbiology (Grade C): leave incubators closed, take the batch logbook only if it is safe to do so.
Roof terrace is not an escape route. Assembly point AP 1 (north) for staff of Level 3 offices.

CORVANE BIOLOGICS

Health, Safety and Environment
Building B, Industriezone Rottenmatte


Building B, Level 3: technical floor and QC

Drawing no.	Revision
CB-B-FS-102	C
Scale	**Sheet**
1:250	2 of 4
Approved	**Date**
R. Andenmatten, HSE manager	09/30/2026

Flucht- und Rettungsplan · Fire evacuation and safety plan

Corvane Biologics AG · Industriezone Rottenmatte, Visp · Site plan Rottenmatte: assembly points

Notruf / Emergency **118 · internal 2222**

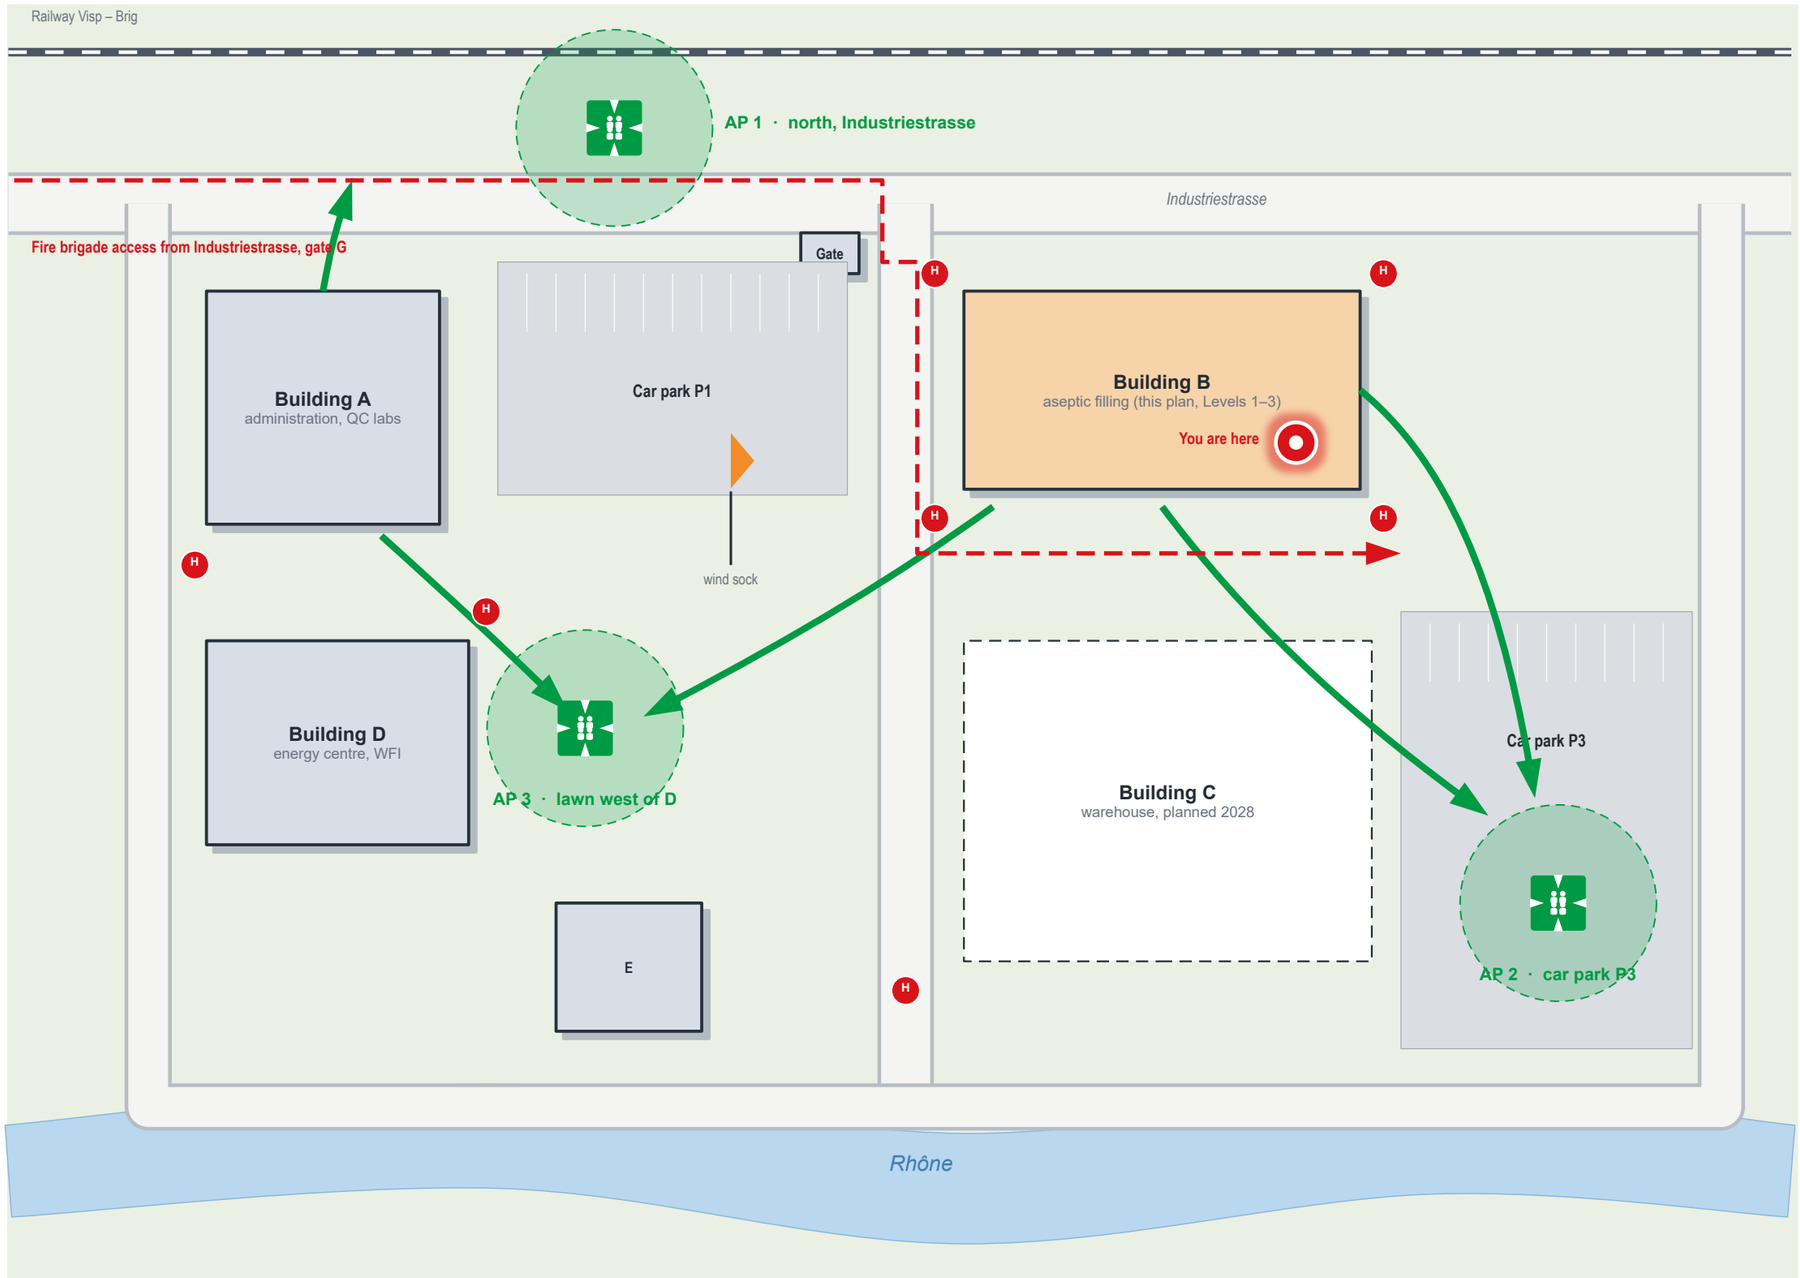

Site legend

- Assembly point / Sammelplatz
- Building exit used for evacuation
- Evacuation direction
- Fire brigade access route
- Hydrant
- River Rhône
- Car park
- Building B (this plan)

Area	Fire warden (day)	Deputy
B, Level 1	M. Imboden	S. Bumann
B, Level 2	Shift leader FL-3	Shift leader FL-5
B, Level 3	P. Theler	N. Furrer
A, all	C. Ruppen	D. Clausen
D and E	L. Bregy	on-call engineer

N

0 20 40 60 80 m (approx. 1:1000)

Assembly points

AP 1: Buildings A and D, Level 3 offices of B. AP 2: Building B Levels 1–2, contractors. AP 3: energy centre and wastewater staff.
Wardens report head counts to the incident commander at the gate (radio channel 3). Do not return before the all-clear.
In case of a gas release, choose the assembly point upwind according to the wind sock.

CORVANE BIOLOGICS

Health, Safety and Environment
Building B, Industriezone Rottenmatte

Site plan Rottenmatte: assembly points

Drawing no. CB-B-FS-103	Revision C
Scale approx. 1:1000	Sheet 3 of 4
Approved R. Andenmatten, HSE manager	Date 09/30/2026

Sicherheitsinformation · Safety information

Corvane Biologics AG · Industriezone Rottenmatte, Visp · Safety signs, procedures and contacts

Notruf / Emergency — **118 · internal 2222**

Safety signs used on the plans



Emergency exit
Notausgang



Fire extinguisher
Feuerlöscher



Fire hose reel
Wasserlöschposten



Manual call point
Handfeuermelder



First aid
Erste Hilfe




Defibrillator
Defibrillator (AED)



Eye wash station
Augendusche



Emergency shower
Notdusche



Assembly point
Sammelplatz

Evacuation procedure

Alarm — fire alarm sounds or call point pressed

→ **Secure** — stop filling, close isolators and doors

→ **Leave** — nearest exit, no lifts, gowns stay on

→ **Assemble** — report to the warden at your assembly point

→ **All-clear** — only the incident commander gives it

Emergency contacts

Who	Number	When
Internal emergency (site control room)	2222	always first, 24 h
Fire brigade	118	via control room, or directly if no answer
Ambulance	144	injuries, collapse
Police	117	security incidents
Toxicological information	145	exposure to chemicals
HSE manager on duty	+41 27 948 22 60	after the emergency services

Revisions

Rev.	Date	Change	By
A	2024-03-15	First issue after Building B handover	R. Andenmatten
B	2025-06-02	FL-5 suite and external stair E3 added	R. Andenmatten
C	2026-09-30	Level 3 QC labs, AED positions, assembly point AP 3	L. Bregy

Plan set

Sheets

101 Building B, Level 2
102 Building B, Level 3
103 Site plan, assembly points
104 Signs, procedures, contacts

Posting

Plans are posted at every stair landing and lift lobby, oriented to the viewer, with the you-are-here marker moved to the posting location.

Drawing layers

Zones · Architecture · Escape routes · Safety · Annotations. The 5 m survey grid is kept on a non-printing layer.

Basis

Cantonal fire protection directive, ISO 7010 sign shapes, ISO 23601 plan layout, EU GMP Annex 1 grades.

Building B, section: your level



Alarm zone	Area	Detection
B-11	Level 1, warehouse	aspirating
B-21	Level 2, clean suite	aspirating
B-22	Level 2, corridor, south	point smoke
B-31	Level 3, AHU rooms	duct smoke
B-32	Level 3, labs, offices	point smoke

CORVANE BIOLOGICS

Health, Safety and Environment
Building B, Industriezone Rottenmatte

Safety signs, procedures and contacts

Drawing no. CB-B-FS-104	Revision C
Scale –	Sheet 4 of 4
Approved R. Andenmatten, HSE manager	Date 09/30/2026