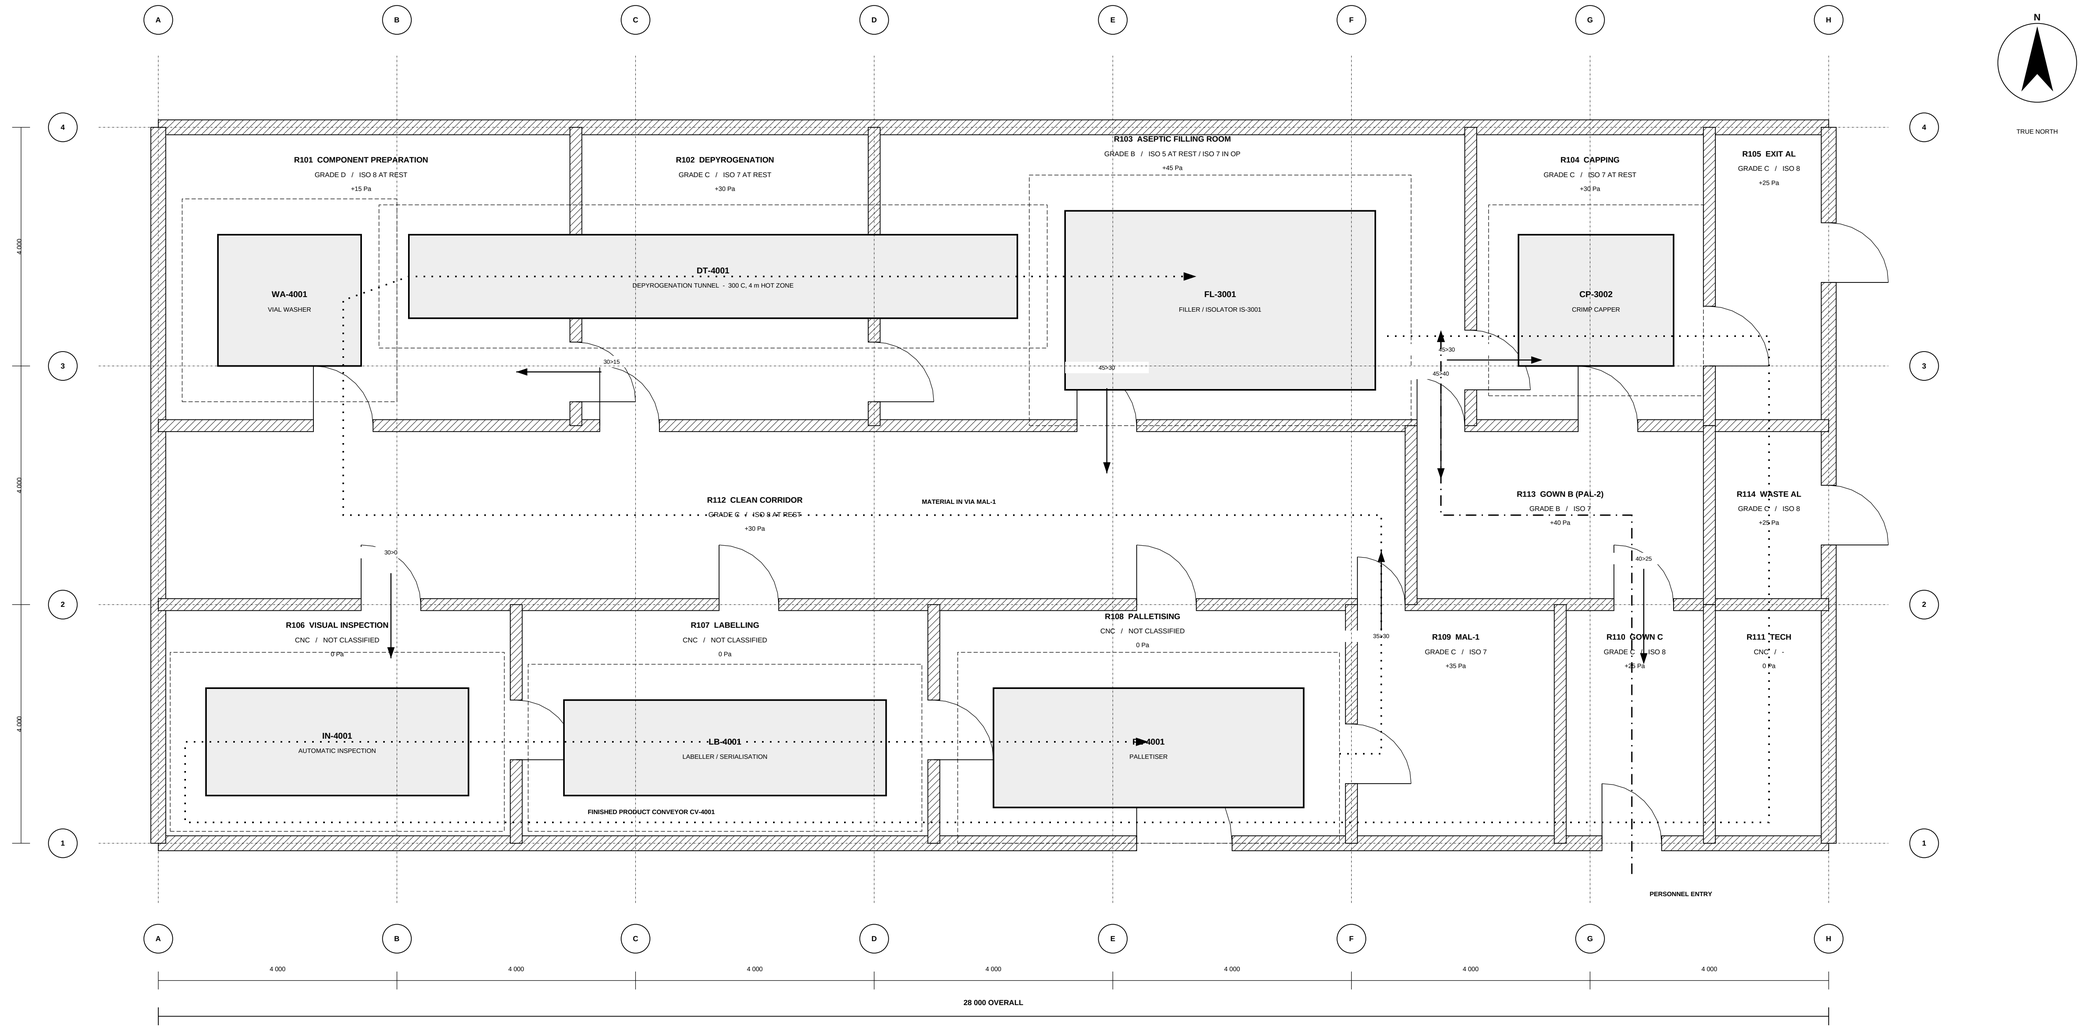


ROOM SCHEDULE

CLASSIFICATION TO ISO 14644-1 AND EU GMP ANNEX 1

ROOM	ROOM NAME	GRADE	AT REST	IN OP.	AREA m2	ACH /h	dP Pa	TEMP C	RH %
R101	COMPONENT PREPARATION AND WASHING	D	ISO 8	ISO 8	35.0	20	+15	20 +/- 2	45 +/- 10
R102	DEPYROGENATION AND STERILE TRANSFER	C	ISO 7	ISO 8	25.0	35	+30	20 +/- 2	45 +/- 10
R103	ASEPTIC FILLING ROOM	B	ISO 5	ISO 7	50.0	60	+45	20 +/- 2	45 +/- 5
R104	CAPPING	C	ISO 7	ISO 8	20.0	35	+30	20 +/- 2	45 +/- 10
R105	VIAL EXIT AIRLOCK	C	ISO 8	ISO 8	10.0	25	+25	20 +/- 2	45 +/- 10
R106	VISUAL INSPECTION	CNC	-	-	24.0	6	0	22 +/- 3	50 +/- 15
R107	LABELLING AND SERIALISATION	CNC	-	-	28.0	6	0	22 +/- 3	50 +/- 15
R108	PALLETISING AND DESPATCH	CNC	-	-	28.0	6	0	22 +/- 3	50 +/- 15
R109	MATERIAL AIRLOCK MAL-1	C	ISO 7	ISO 8	14.0	40	+35	20 +/- 2	45 +/- 10
R110	GOWNING GRADE C (PAL-1)	C	ISO 8	ISO 8	10.0	25	+25	20 +/- 2	45 +/- 10
R111	TECHNICAL / EQUIPMENT	CNC	-	-	8.0	4	0	25 max	-
R112	CLEAN CORRIDOR	C	ISO 8	ISO 8	63.0	25	+30	20 +/- 2	45 +/- 10
R113	GOWNING GRADE B (PAL-2)	B	ISO 5	ISO 7	15.0	60	+40	20 +/- 2	45 +/- 5
R114	WASTE AIRLOCK	C	ISO 8	ISO 8	6.0	25	+25	20 +/- 2	45 +/- 10

NOTES

1. ALL DIMENSIONS IN MILLIMETRES UNLESS NOTED OTHERWISE. PLAN DRAWN TO 1:50 ON ANSI D.
2. WALL CONSTRUCTION: 250 mm MODULAR GRP FACED PANEL, FLUSH GLAZED, COVED FLOOR / WALL JUNCTION.
3. DASHED OUTLINES INDICATE MAINTENANCE AND OPERATOR CLEARANCE ENVELOPES, 700 mm MINIMUM.
4. ALL AIRLOCK DOORS INTERLOCKED IN PAIRS; INTERLOCK OVERRIDDEN ON FIRE ALARM.
5. GRID A TO H AND 1 TO 4 AT 4 000 CENTRES CORRESPONDS TO THE STRUCTURAL COLUMN GRID.
6. PRESSURE CASCADE VALUES ARE NOMINAL AT REST WITH ALL DOORS CLOSED.
7. DT-4001 PENETRATES THE R101 / R102 AND R102 / R103 PARTITIONS; SEE DETAIL OB-A7-DET-4012.
8. ILLUSTRATIVE SPECIMEN DRAWING. ALL ROOM NUMBERS, TAGS AND FIGURES ARE FICTIONAL.

FLOW KEY

- PERSONNEL FLOW (GOWNING SEQUENCE C THEN B)
- MATERIAL AND FINISHED PRODUCT FLOW
- AIR PRESSURE CASCADE, VALUES IN Pa

REV	DATE	DESCRIPTION	BY	CHK	APPROVED
1	2026-09-18	HAZOP ACTIONS 12, 17 AND 24 INCORPORATED	RD	MIB	SA
0	2026-07-14	ISSUED FOR DESIGN FREEZE	RD	MIB	TV
B	2026-05-22	ISSUED FOR HAZOP	RD	MIB	TV
A	2026-03-06	ISSUED FOR INTERNAL REVIEW	RD	MIB	TV

ORYVIA BIOLOGICS SA
BIOLOGICS MANUFACTURING

AURELIA SITE - BUILDING 7
DRUG SUBSTANCE / DRUG PRODUCT

DATE: **2026-09-18**

DRAWING TITLE

GENERAL ARRANGEMENT - PLAN AT LEVEL +0.000

STERILE FILLING SUITE, BUILDING 7 WEST WING

ROOM CLASSIFICATION AND EQUIPMENT LAYOUT

DRAWN	CHECKED	PROCESS APPROVAL	QUALITY APPROVAL	ENGINEERING CONTRACTOR
R. DELACOUR 2026-09-18	M. ISHIKAWA-BRENT 2026-09-18	T. VANHOUTE 2026-09-18	S. ABERKANE 2026-09-18	VELDRAN ENGINEERING PARTNERS

ILLUSTRATIVE DOCUMENT - NOT FOR CONSTRUCTION

DRAWING NUMBER	REV	SHEET	SCALE	SIZE
OB-A7-GA-4001	2	1 OF 1	1:50	ANSI D